

GENERAL NOTES:

- ① FALL THROUGH TABLET FEEDER FROM INLET INVERT TO OUTLET INVERT IS ONE QUARTER INCH $\pm \frac{1}{32}$ ".
- ② FINISHED GRADE MUST BE MAINTAINED AT LEAST SIX INCHES BELOW TOP OF LID.
- ③ INLET, OUTLET, AND RISER HUBS ACCEPT STANDARD SCHEDULE 40 PVC PIPES AND FITTINGS.
- ④ WHERE TABLET FEEDER IS INSTALLED WITHOUT MOUNTING BRACKETS, INSTALL ON FOUR INCH SAND OR FINE GRAVEL LEVELING PAD.
- ⑤ RATED FOR 20,000 - 200,000 GPD.

TOP VIEW

BOTTOM VIEW

FEED TUBE CAP

ERGONOMICALLY
DESIGNED HANDLE

CLEARCHECK
FEED TUBE

INTERMEDIATE
FLOW TIER


6" SCHEDULE 40
PVC INLET HUB

4" SCHEDULE 40
PVC RISER HUB

UPPER
FLOW TIER

INERT
DRAINAGE TIER

6" SCHEDULE 40
PVC OUTLET HUB

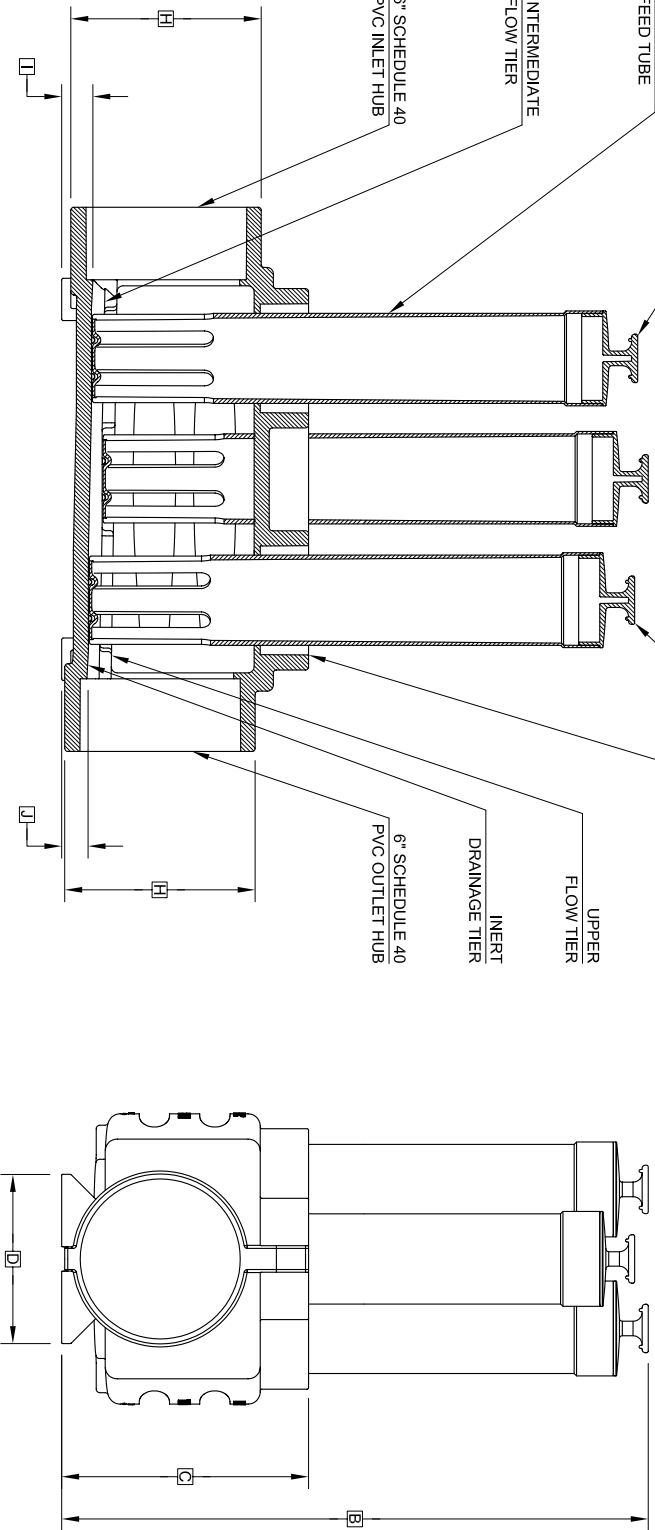

SECTION A-A

INLET END VIEW

PROJECT ENGINEERS APPROVAL:

I (WE) HEREBY CERTIFY THAT THIS DRAWING HAS BEEN CHECKED AND IS APPROVED FOR USE IN CONFORMITY WITH THE CONTRACT DOCUMENTS.

DATE: _____

NAME: _____

CONTRACTOR'S CERTIFICATION:

I (WE) HEREBY CERTIFY THAT THIS DRAWING HAS BEEN CHECKED AND IS APPROVED FOR USE IN CONFORMITY WITH THE CONTRACT DOCUMENTS.

DATE: _____

NAME: _____

CRITICAL DIMENSIONS

A	1'-10 1/2"	N	0'-5"
B	2'-0 1/4"	O	0'-5 3/4"
C	0'-10 3/16"	P	
D	0'-7"	Q	
E	0'-4 9/16" (TYP)	R	
F	0'-1 1/2" (TYP)	S	
G	1'-0"	T	
H	0'-7 7/8"	U	
I	0'-1 1/4"	V	
J	0'-1"	W	
K	1'-2 7/8"	X	
L	0'-6"	Y	
M	0'-3"	Z	